
Vanguard Laboratory
2635 Parkmont Ln
Olympia, Wa 98502
360-967-7010

Certificate of Analysis


NAD+ 1000 mg

Report To:
Chameleon Peptides

Compound: NAD+
Amount: 1000 mg
Laboratory ID: V260918-42 007
Lot Number: B003A
Date Released: 10/5/2026

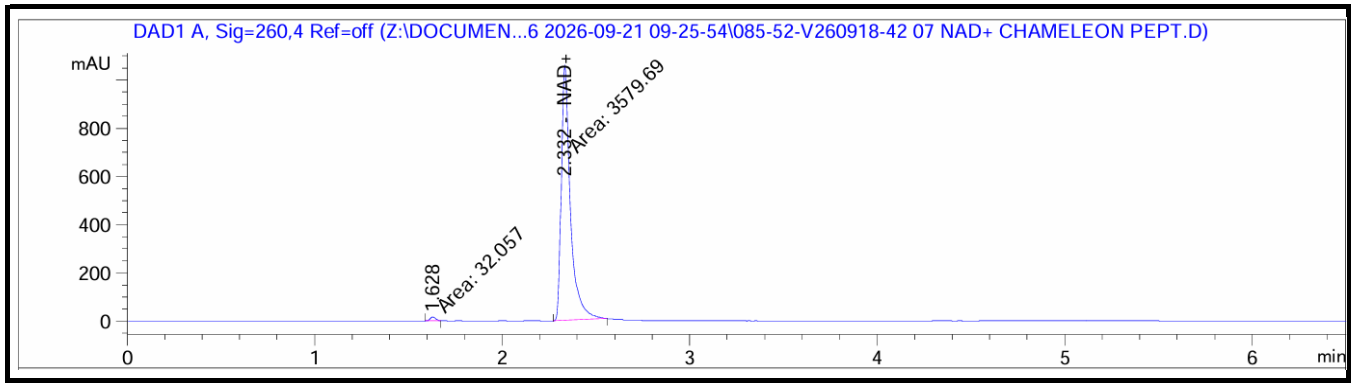

Analysis	Method	Result
Chromatographic Purity (Total)	HPLC-UV/VIS	>99.80%
Chromatographic Purity (NAD+)	HPLC-UV/VIS	99.11%
Chromatographic Purity (Nicotinamide)	HPLC-UV/VIS	1.63%
Quantity: NAD+	HPLC-UV/VIS	1125 mg

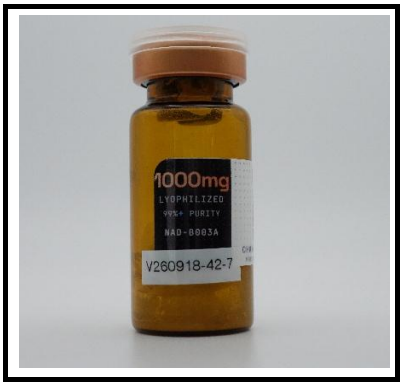

ISO 17025:2017 ACCREDITED LABORATORY

Report By: Dustin Newman, Laboratory Director on 10/5/2026

Approved By: Tori Johnson, Operations Manager on 10/5/2026

Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch. Blend purity is the combined chromatographic area % of peaks identified as the intended components, not absolute mass purity. It does not establish individual component purity, quantity, or ratio. Co-eluting or otherwise undetected impurities may not be included, despite peak-purity and spectral-library review.

Vanguard Laboratory
2635 Parkmont Ln
Olympia, Wa 98502
360-967-7010

Certificate of Analysis

NAD+ 1000 mg

Report To:
Chameleon Peptides

Compound: NAD+
Amount: 1000 mg
Laboratory ID: V260918-42 007
Lot Number: B003A
Date Released: 10/5/2026

Analyte	Method	LOQ (ppm)	Result (ppm)
Arsenic (As)	ICP-MS	0.01	ND
Cadmium (Cd)	ICP-MS	0.01	ND
Lead (Pb)	ICP-MS	0.01	0.01
Mercury (Hg)	ICP-MS	0.005	ND

Run ID: 261002.2

Analysis	Method	Result
Endotoxins	LAL	<10.0 EU/Vial
Sterility	USP <71>	No Growth Detected

Run ID: 260930, 260921

Report By: Dustin Newman, Laboratory Director on 10/5/2026

Approved By: Tori Johnson, Operations Manager on 10/5/2026

ND: Non-Detect
LOD: Limit of Quantification

ISO 17025:2017 ACCREDITED LABORATORY

Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.